



- 1) YOKE TO BE Y-502 FORD OR APPROVED EQUAL.
- 2) BACKFLOW PREVENTER TO BE RPZ MEETING ASSE STANDARD 1013.
- 3) CUSTOMER IS RESPONSIBLE FOR OPERATION AND MAINTENANCE OF BACKFLOW PREVENTER.
- 4) METER BOX MUST BE CARSON 2200-18 WITH TOUCH READ HOLE LID OR APPROVED EQUAL.
- 5) METER SHALL BE SENSUS WITH RADIO-READ UNIT

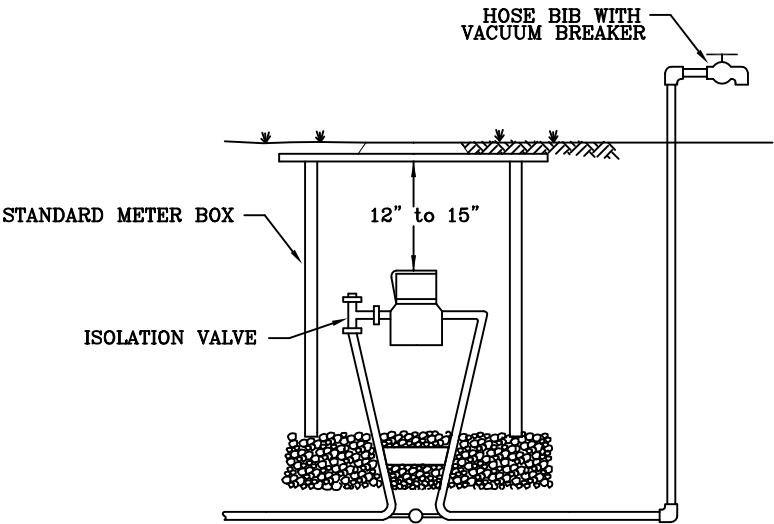

ALTERNATE CONFIGURATION FOR LIMITED USE

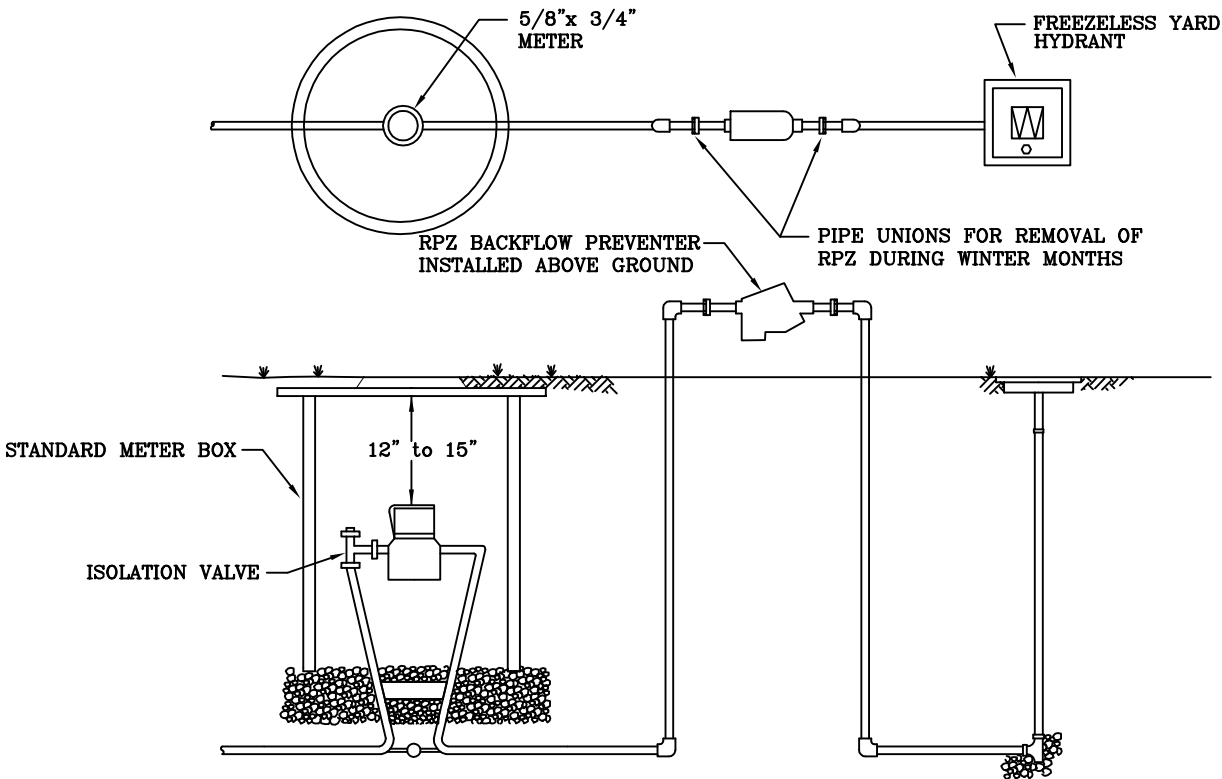

CONFIGURATION FOR PERMANENT SYSTEMS

REVISIONS				TYPICAL SEWER SUBTRACTION METER CONFIGURATION	DRAWING W-06
NO.	DATE				
ORIGINAL	12/01/06				